


Report: Sound Level Measurements
SWEDFAN 2-stage fan 2xAVH160.200.4.8 (50 Hz)

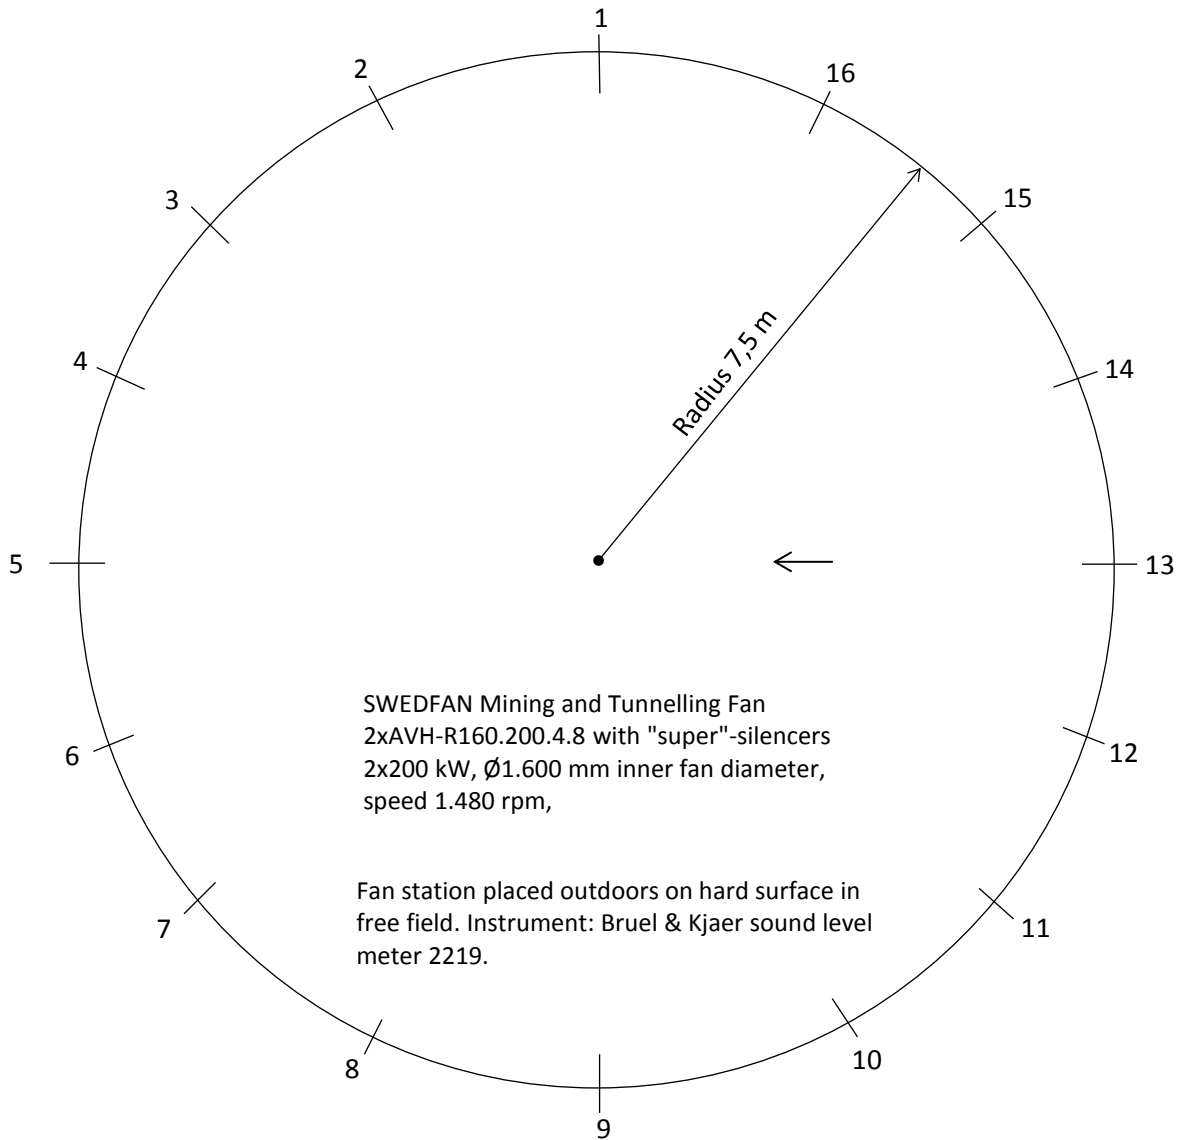

Results:

The measuring points were chosen according to BS 4196.
Background sound level was <50 dB(A) (light breeze).

Point 1: 78 db(A)	Point 5: N/A	Point 9: 78 db(A)	Point 13: 86 db(A)
Point 2: 77 db(A)	Point 6: 79 db(A)	Point 10: 76 db(A)	Point 14: 77 db(A)
Point 3: 78 db(A)	Point 7: 78 db(A)	Point 11: 76 db(A)	Point 15: 76 db(A)
Point 4: 79 db(A)	Point 8: 77 db(A)	Point 12: 77 db(A)	Point 16: 76 db(A)