


95STS Series Single Model	Maximum Recommended Service Flow Rates			Max Flow To Drain USGPM l/s	Pipe Size		Media Per Tank m3	Mineral Tank		Installation			Shipping Weight lbs kg	Operating Weight lbs	
	0-3 PPM	3-8 PPM	8-15 PPM		Service	Drain		Per Tank	Diameter	Height	Height	Depth			Width
	USGPM	USGPM	USGPM		in	in		ft3	in	in	in	in			in
95STS MG14- 1.5"	5	3	2	10	1.5"	1"	2.75	14	66	81	20	20	431	831	
	0.32	0.19	0.13	0.63	38	25	0.08	356	1676	2057	508	508	195	377	
95STS MG16- 1.5"	7	4	2.5	15	1.5"	1"	3.5	16	66	81	22	22	571	1,071	
	0.44	0.25	0.16	0.95	38	25	0.10	406	1676	2057	559	559	259	486	
95STS MG18- 1.5"	9	5	3.5	15	1.5"	1"	4.5	18	68	83	24	24	676	1,276	
	0.57	0.32	0.22	0.95	38	25	0.13	457	1727	2108	610	610	307	579	
95STS MG21- 1.5"	12	7	5	25	1.5"	1"	6	21	68	83	27	27	849	1,649	
	0.76	0.44	0.32	1.58	38	25	0.17	533	1727	2108	686	686	385	748	

System has basic chemical pump for continuous feed. For varying flowrates flow pace chemical feed is required (optional).

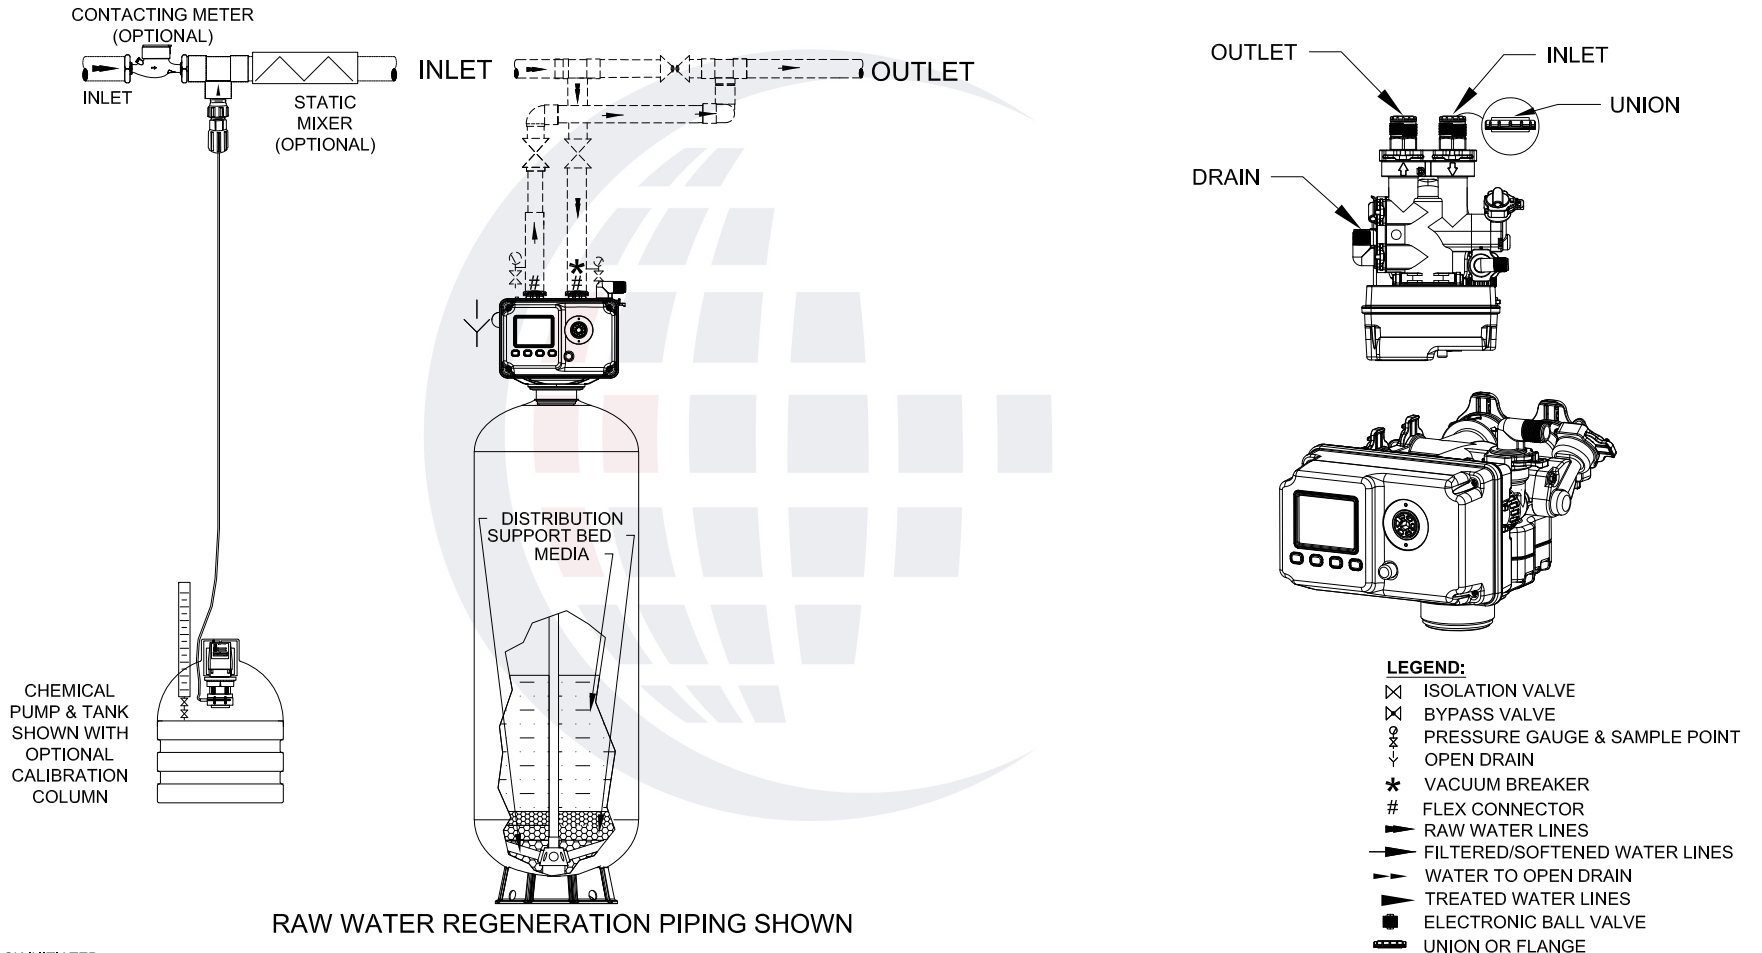

NOTES

- SINGLE FILTER, CALENDAR CLOCK INITIATED
- FILTER IS EQUIPPED WITH 1.5" VALVE ELECTRONIC BALL VALVE
- MAXIMUM RECOMMENDED SYSTEM PRESSURE IS 100 PSI (690 kPa) AND MINIMUM INLET PRESSURE IS 40 PSI.
- MAXIMUM RECOMMENDED SYSTEM TEMPERATURE IS 100 °F (38 °C).
- REQUIRES 120 VOLT, 1 PHASE, 60 Hz ELECTRICAL POWER.
- ALL EXTERNAL PIPING, FITTINGS, AND VALVES SHOWN BY BROKEN LINES ARE SUPPLIED BY OTHERS.
- MINERAL TANKS AND MEDIA ARE NSF APPROVED.
- DUE TO SLIGHT EXPANSION AND CONTRACTION OF MINERAL TANK, PIPING MUST BE DESIGNED TO ALLOW SOME MOVEMENT. AS WELL AS BE PROTECTED FROM VACUUM. FLEX CONNECTORS AND A VACUUM BREAKER MAY BE REQUIRED. FAILURE TO INSTALL EITHER OF THEM OR IMPROPERLY INSTALL THEM MAY VOID THE WARRANTY.
- AVAILABLE IN 1", 1.25", 1.5" PIPING CONNECTION.

- FLOOR DRAINS MUST BE SIZED TO CARRY THE MAX. LISTED FLOW TO DRAIN.
- REFER TO THE INSTALLATION AND OPERATION MANUAL FOR FURTHER DETAILS.
- USE PROPER UNION OR FLANGE FOR THE PIPE CONNECTION TO VALVE FOR EASY MAINTENANCE.
- SYSTEM MUST BE INSTALLED TO COMPLY WITH ALL FEDERAL, STATE, PROVINCIAL, & LOCAL CODES.
- MEDIA BED CONSISTS OF NSF APPROVED MEDIA CONSISTS OF (FROM TOP TO BOTTOM) ANTHRACITE, MANGANESE GREENSAND ON A GRADED SUPPORT BED
- SYSTEM IS SUPPLIED WITH A GRADUATED CHEMICAL TANK AND STANDARD CONTINUOUS FEED CHEMICAL PUMP. (NOT SHOWN). IF THE SYSTEM HAS VARYING FLOW RATES, AN OPTIONAL FLOW PACED CHEM FEED SYSTEM MUST BE USED.



95STS GREENSAND FILTER 1.5" SINGLE SYSTEM		
THIS DOCUMENT CONTAINS INFORMATION WHICH IS PROPRIETARY TO CANATURE WATERGROUP. THE REPRODUCTION, TRANSFER, OR OTHER EXPLOITATION OF ANY INFORMATION CONTAINED HEREIN IS NOT PERMITTED WITHOUT PRIOR WRITTEN APPROVAL OF CANATURE WATERGROUP. THE MANUFACTURER RESERVES THE RIGHT TO MAKE PRODUCT REVISIONS, WHICH MAY DEVIATE FROM THE SPECIFICATIONS AND DESCRIPTIONS STATED HEREIN WITHOUT OBLIGATION TO CHANGE PREVIOUSLY MANUFACTURED PRODUCTS OR TO NOTE THE CHANGE. NOT DRAWN TO THE SCALE UNLESS OTHERWISE SPECIFIED.		
Project:	Date: 02-13-2024	Rev
	Dwg# 95STS MG1.5S	0