


**LEGEND:**


- ⊠ ISOLATION VALVE
- ⊠ BYPASS VALVE
- ⊠ PRESSURE GAUGE & SAMPLE POINT
- ⊠ OPEN DRAIN
- ★ VACUUM BREAKER
- ▬ RAW WATER LINES
- ▬ FILTERED WATER LINES
- ▬ WATER TO OPEN DRAIN
- ▬ TREATED WATER LINES

STAGER  
CONTROLLER



DCF Series Quadplex Model	Typical		Peak	Max Flow To Drain		Pipe Size		Media		Mineral Tank		Installation			Shipping Weight	Operating Weight
	Service Flow Rate					Service	Drain	Per Tank	Diameter	Height	Height	Depth	Width			
	USGPM	USGPM	USGPM	in	in	ft3	in	in	in	in	in	in	in	lbs	lbs	
DCF 30-2"	60	100	50	2"	2"	12.5	30	88	99	36	135	6,998	13,398			
	3.79	6.31	3.15	50	50	0.35	762	2235	2515	914	3429	3,175	6,079			
DCF 36-2"	84	140	70	2"	2"	17.6	36	87	100	42	159	9,306	18,506			
	5.30	8.83	4.42	50	50	0.50	914	2210	2540	1067	4039	4,222	8,397			
DCF 42-3"	116	192	95	3"	3"	24.0	42	95	108	48	183	13,398	26,998			
	7.32	12.11	5.99	75	75	0.68	1067	2413	2743	1219	4648	6,079	12,250			
DCF 48-3"	152	252	125	3"	3"	31.0	48	94	109	54	207	17,380	34,580			
	9.59	15.90	7.89	75	75	0.88	1219	2388	2769	1372	5258	7,886	15,690			
DCF 63-4"	260	432	215	3"	4"	54.0	63	96	111	69	267	32,754	55,554			
	16.40	27.25	13.56	100	100	1.53	1600	2438	2819	1753	6782	14,861	25,206			

Service based on 3 usgpm/ft2, Peak based on 2.5 usgpm/ft2. System must be designed to draw air continuously.  
Hydrocharger (air induction) system sold separately.

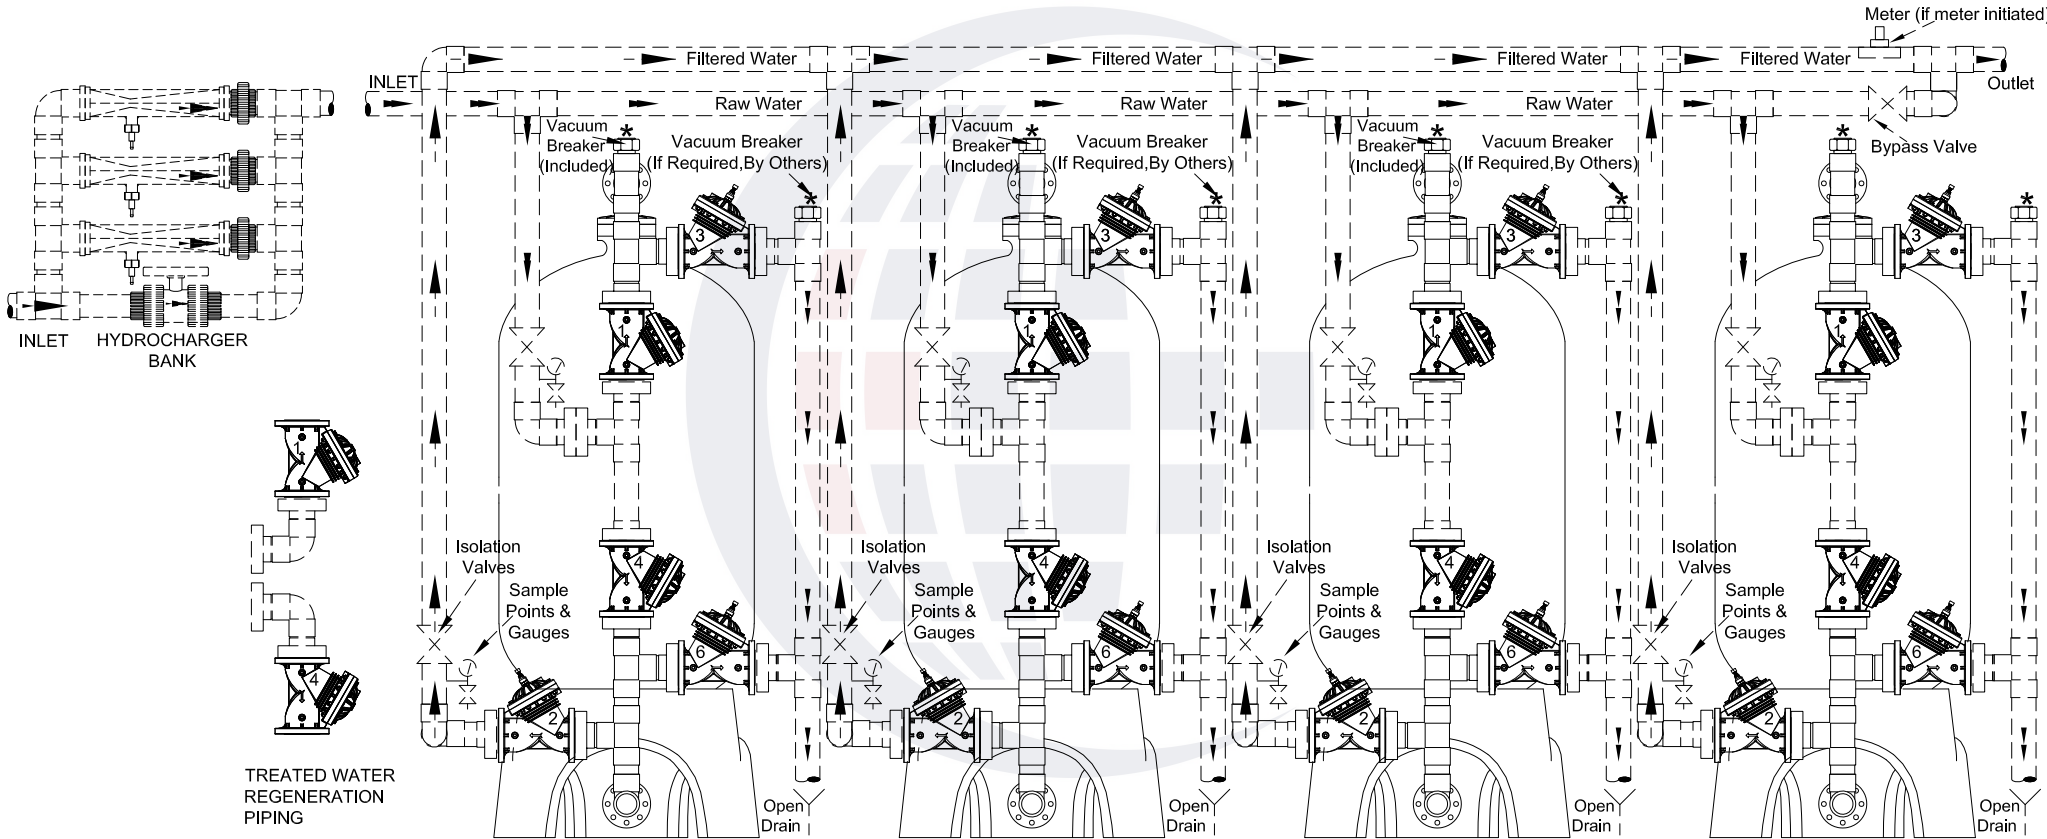

**RAW WATER REGENERATION PIPING SHOWN**

**NOTES:**

- MAXIMUM RECOMMENDED SYSTEM PRESSURE IS 100 PSIG (690 kPa).
- MAXIMUM RECOMMENDED SYSTEM TEMPERATURE IS 90° F (32°C).
- TANKS, AND MEDIA ARE NSF APPROVED. TRIPOD TANKS TO BE SECURELY ATTACHED TO THE FLOOR.
- ALL PIPING, FITTINGS, INTERCONNECTING PIPING, ISOLATION & SAMPLE VALVES AND GAUGES SHOWN BY BROKEN LINES ARE BY OTHERS
- SUPPLIED MANIFOLD IS SCH 80 PVC AND IS SUPPLIED WITH ONE VACUUM BREAKER. RECOMMENDED AIR RELEASE VALVE IS BY OTHERS. SYSTEM CAN BE PIPED AS RAW WATER OR TREATED WATER REGENERATION.
- ALL PIPING MUST BE PROPERLY SUPPORTED AND BRACE TO HANDLE THE THRUST OF THE CHANGE OF WATER FLOW (BY OTHERS)
- GLASS FIBER REINFORCED THERMOPLASTIC DIAPHRAGM VALVES ARE SEQUENCED BY AN ELECTRONIC MULTIPORT STAGER. ELECTRICAL POWER REQUIRED - 120 VOLT, 1 PHASE, 60 HZ. MULTI-TANK SYSTEMS ARE SERIES REGENERATION.

- SYSTEM MUST BE INSTALLED TO COMPLY WITH ALL FEDERAL, STATE, PROVINCIAL AND LOCAL CODES.
- FLOOR DRAINS MUST BE SIZED TO CARRY THE MAXIMUM LISTED FLOW TO DRAIN.
- REFER TO THE INSTALLATION AND OPERATION MANUAL FOR FURTHER DETAILS.
- MEDIA BED CONSISTS OF NSF APPROVED CALCIUM CARBONATE, MAG OXIDE AND FINE FILTER SAND ON A GRADED SUPPORT BED
- SYSTEM MUST BE DESIGNED SO THE HYDROCHARGER BANK DRAWS AIR CONTINUOUSLY.

**DCF SERIES CHEM FREE  
QUADRAPLEX FILTER SYSTEM**

THIS DOCUMENT CONTAINS INFORMATION WHICH IS PROPRIETARY TO CANATURE WATERGROUP. THE REPRODUCTION, TRANSFER, OR OTHER EXPLOITATION OF ANY INFORMATION CONTAINED HEREIN IS NOT PERMITTED WITHOUT PRIOR WRITTEN APPROVAL OF CANATURE WATERGROUP. THE MANUFACTURER RESERVES THE RIGHT TO MAKE PRODUCT REVISIONS, WHICH MAY DEVIATE FROM THE SPECIFICATIONS AND DESCRIPTIONS STATED HEREIN WITHOUT OBLIGATION TO CHANGE PREVIOUSLY MANUFACTURED PRODUCTS OR TO NOTE THE CHANGE. NOT DRAWN TO THE SCALE UNLESS OTHERWISE SPECIFIED.



Project:	Date: 2/20/024	Rev 0
Dwg# DCF 04		