
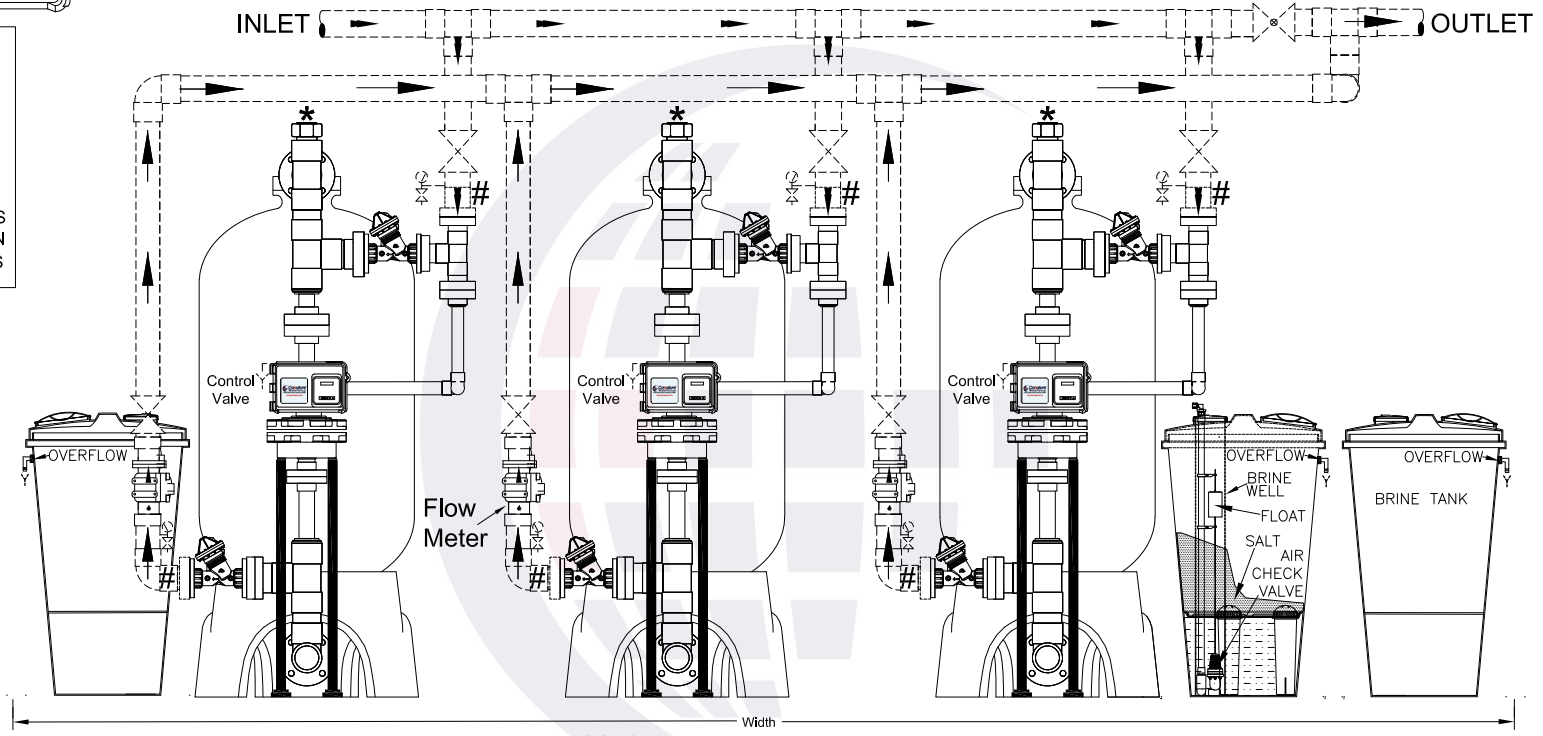


Model (Triplex)	FLOW RATE IS PER TANK										Dimensions			Installation		Shipping Weight lbs	Operating Weight lbs				
	Capacity		Resin		Salt Usage		Critical		3"		Mineral Tank		Brine Tank		Height mm			Depth mm	width mm		
	@6 lbs/ft3	@10 lbs/ft3	ft3	m3	@6 lbs/ft3	@10 lbs/ft3	Flow USGPM	@ 15 PSI	@ 25 PSI	To Drain USGPM	in	mm	in	mm							
FHF 360-3C"	264,000	324,000	12	0.34	72	32.67	120	54.45	60	3.79	156	215	25	1.58	30 x 72	33 x 53	107	66	240	3,739	13,939
	324,000	286,000	0.34	13	72	78	130	65	152	210	25	30 x 72	38 x 55	107	762 x 1829	840 x 1335	2,705	1,676	6,096	1,697	6,325
FHF 390-3C"	286,000	351,000	13	0.37	78	35.39	58.98	4.10	9.59	13.25	152	210	25	1.58	30 x 72	36 x 48	107	66	252	3,988	16,888
	351,000	330,000	0.37	15	78	90	150	75	142	200	25	30 x 72	38 x 55	107	762 x 1829	965 x 1397	2,705	1,676	6,401	1,809	7,662
FHF 450-3C"	330,000	405,000	15	0.42	90	40.83	68.06	4.73	8.96	12.62	152	210	25	1.58	30 x 72	36 x 48	107	66	252	4,369	17,269
	405,000	374,000	0.42	17	90	102	170	85	138	190	25	30 x 72	36 x 48	107	762 x 1829	965 x 1397	2,705	1,676	6,401	1,982	7,835
FHF 510-3C"	374,000	459,000	17	0.48	102	46.28	77.13	5.36	8.71	11.99	138	247	35	1.58	30 x 72	36 x 48	106	72	264	4,517	17,417
	459,000	418,000	0.48	19	102	114	190	95	180	247	35	36 x 72	36 x 48	106	762 x 1829	914 x 1220	2,705	1,676	6,248	2,049	7,902
FHF 570-3C"	418,000	513,000	19	0.54	114	51.72	86.21	5.99	11.36	15.58	247	321	21	2.21	36 x 72	36 x 48	106	72	264	5,474	19,574
	513,000	440,000	0.54	20	114	51.72	86.21	5.99	11.36	15.58	321	245	35	915 x 1829	914 x 1220	2,680	1,829	6,706	2,484	8,881	
FHF 600-3C"	440,000	540,000	20	0.57	120	54.45	90.74	6.31	11.17	15.46	245	221	21	2.21	36 x 72	42 x 48	106	72	282	5,752	24,052
	540,000		0.57		120	54.45	90.74	6.31	11.17	15.46	221	221	21	915 x 1829	1067 x 1219	2,680	1,829	7,163	2,610	10,913	



- NOTES:**
- SOFTENER IS EQUIPPED WITH A 115 VOLT, ELECTRONIC SIDE MOUNTED REGENERATION CONTROL VALVE WITH 3" SERVICE INLET AND OUTLET THERMOPLASTIC DIAPHRAGM VALVES.
 - SOFTENER MANIFOLD SUPPLIED (MINERAL TANK TO THE DIAPHRAGM VALVES) IS SCH 80 PVC.
 - FIBERGLASS MINERAL TANKS AND MEDIA ARE NSF APPROVED
 - FIBERGLASS MINERAL TANKS ONLY ARE RATED FOR MAX PRESSURE 150 PSI(1034 KPa)
 - DUE TO SLIGHT EXPANSION AND CONTRACTION OF MINERAL TANK, PIPING MUST BE DESIGNED TO ALLOW SOME MOVEMENT. AS WELL AS BE PROTECTED FROM VACUUM. FLEX CONNECTORS(#) AND A VACUUM BREAKER (*) MAY BE REQUIRED. ***FAILURE TO INSTALL EITHER OF THEM OR IMPROPERLY INSTALL THEM MAY VOID THE TANK WARRANTY. COMPLETE UNIT WARRANTY DETAILS ON DOCUMENT #80150800 AVAILABLE ON THE WEB SITE.
 - MAXIMUM RECOMMENDED OPERATING LIMITS ARE 100 PS (690 kpa) AND TEMPERATURE 90° F (32°C).
 - ALL EXTERNAL AND INTERCONNECTING PIPING, FITTINGS, ISOLATION / BYPASS VALVES, PRESSURE GAUGES, SAMPLE POINTS, FLANGES & UNIONS ETC SHOWN BY BROKEN LINES ARE SUPPLIED BY OTHERS
 - SOFTENER UNITS FHF 570 AND LARGER REQUIRE 1" PVC BRINE LINE PIPING NOT SUPPLIED. (BY OTHERS)
 - SYSTEM MUST BE INSTALLED TO COMPLY WITH ALL FEDERAL, STATE, PROVINCIAL, AND LOCAL CODES.
 - ALL PIPING MUST BE PROPERLY SUPPORTED AND BRACED TO HANDLE THE THRUST OF THE CHANGE OF WATER FLOW (BY OTHERS).
 - FLOOR DRAINS MUST BE SIZED TO CARRY THE MAX. LISTED FLOW TO DRAIN.
 - DIMENSIONS SHOWN ARE THE ***MINIMUM*** REQUIRED. THIS INCLUDES ONLY 6" (153 mm) IN FRONT OF THE SYSTEM AND BETWEEN MINERAL TANKS. THIS ALSO INCLUDES ONLY 3" (76 mm) AROUND THE BRINE TANKS. MORE SPACE IS RECOMMENDED FOR EASY MAINTENANCE. **FOR PIPING CLARITY, EXTRA DISTANCE SHOWN BETWEEN MINERAL TANKS**
 - REFER TO THE INSTALLATION AND OPERATION MANUAL FOR FURTHER DETAILS.

- SYSTEM HAS NO RAW WATER BYPASS DURING REGENERATION AS STANDARD.
- MULTI TANK SOFTENER, IMMEDIATE METER INITIATED.
- DEMAND RECALL SYSTEM. ONE UNIT ALWAYS ON LINE. OTHER UNIT(S) ARE BROUGHT ON LINE BASED ON TOTAL SYSTEM FLOW RATE. UNITS
- SYSTEM INTERLOCKED TO ONLY ALLOW ONE UNIT TO REGENERATE AT A TIME

**HIGH FLOW FHF SERIES SOFTENER
3-1.5 TRIPLEX DEMAND RECALL SYSTEM**

THIS DOCUMENT CONTAINS INFORMATION WHICH IS PROPRIETARY TO CANATURE WATERGROUP. THE REPRODUCTION, TRANSFER, OR OTHER EXPLOITATION OF ANY INFORMATION CONTAINED HEREIN IS NOT PERMITTED WITHOUT PRIOR WRITTEN APPROVAL OF CANATURE WATERGROUP. THE MANUFACTURER RESERVES THE RIGHT TO MAKE PRODUCT REVISIONS, WHICH MAY DEVIATE FROM THE SPECIFICATIONS AND DESCRIPTIONS STATED HEREIN WITHOUT OBLIGATION TO CHANGE PREVIOUSLY MANUFACTURED PRODUCTS OR TO NOTE THE CHANGE. NOT DRAWN TO THE SCALE UNLESS OTHERWISE SPECIFIED.

Project _____	Date 23/04/024	Rev _____
Dwg # FHF 3-1.5 T		0

